Single Frame 100% Redundant HVAC





WC Series for Analyzer Shelters and Equipment Room and Similar Enclosures







DESCRIPTIONS:

The Single Frame 100% Redundant HVAC unit is consist of fully redundant HVAC system including two forced ventilation fans in one single frame, and this unit is suitable for controlling the positive pressure, temperature or humidity of the room inside. This system provides cooling, heating, and forced ventilation by positive pressure and using the unit to dilute the flammable gases, toxic gases or vapors inside room through the louvers of the room wall.

The WC series HVAC unit are suitable either for Safe areas or for Zone 1 (or Zone 2) classified areas (according to the EN 60079-10 standard).

MODEL IDENTIFICATION

Characteristics	Units	HVAC (Heating, Ventilation and Air Conditioning Unit)									
		WC07	WC10	WC12	WC14	WC16	WC20	WC24	WC28	WC33	WC35
Cooling Capacity	W	7,500	9,610	11,800	14,600	18,900	22,800	26,100	30,600	34,400	39,800
	BTUH	25,500	32,700	40,100	49,600	64,300	77,500	88,700	104,000	117,000	135,300
Heating Capacity (Steam – note.2)	KW	3 ~ 12				5 ~ 24					
Max. Power Consumption	KW	7.46	9.09	10.79	12.99	16.82	19.32	22.02	25.92	28.02	32.22
Dimension Type	-	2				3			4		
Power Input	V/P/F	380~480VAC / 3Ph / 50-60Hz									
System Redundancy	-	Single Frame									
Refrigerant	-	R134a, R407c									

- 1. Rated at +60°C condensing temperature with 50Hz base (115% for 60 Hz) (R407c refrigerant is subject to have different capacity).
- 2. Steam Condition: Max. Pressure 6.0 barg / Max. Temperature 160 deg C.
- 3. Actual capacity may different depending on running condition
- 4. Specifications are subject to change without notice.

ORDERING INFORMATION

ito iiti oiti		· <u>·</u>						
XX	-	XXX	X	xxx	х	х	-	x
Capacity	-	Volt-Ph-Hz	Classification	Heating	Mounting	Tamb	-	<u>Options</u>
7 ~35 KW		4: 3(4)xxV~	0: None	NON: N/A	F: Free standing	A: -20 °C to 50 °C		1: Motorized damper
*see the table		3: 3Ph.	B: Zone2, IIB	STM: Steam	W: Wall mount	B: -20 °C to 55 °C		2: Room DPS/DPI
X: Redundant (Dual frame)		6: 60Hz, 5: 50Hz	H: Zone1, IIB+H2 E03~24 KW: Electric		H: Horizontal C: -20 °C to 60 °C			3: Chemical filter
			C: Zone1, IIC					4: Humidity control
ecifications by	reques	t	M: Interior : IIC Exterior : IIB					(Multiple option selection available)
	TXX Capacity 7 ~35 KW *see the table X: Redundant (Dual frame)	T ~35 KW 7 ~35 KW *see the table X: Redundant (Dual frame)	1 Capacity Volt-Ph-Hz 7 ~35 KW 4: 3(4)xxV~ "see the table 3: 3Ph. X: Redundant 6: 60Hz 5: 50Hz	XXX X X X X Classification 7 ~ 35 KW 4: 3(4)xxV 0: None 4: 36 Hz 5: 50 Hz 1: 50 Hz	XXX X XXX X XXX Capacity Volt-Ph-Hz Classification Heating	XXX X XXX X X X X X X	XXX X XXX X X 1 Capacity Volt-Ph-Hz Classification Heating Mounting Tamb 7 ~35 KW 4: 3(4)xxV~ 0: None NON: N/A F: Free standing A: -20 °C to 50 °C *see the table 3: 3Ph. B: Zone2, IIB STM: Steam W: Wall mount B: -20 °C to 55 °C X: Redundant (Dual frame) 6: 60Hz, 5: 50Hz H: Zone1, IIB+H2 E03~24 KW: Electric H: Horizontal C: -20 °C to 60 °C C: Zone1, IIC M: Interior : IIC M: Interior : IIC	XXX X XXX X X - I Capacity Volt-Ph-Hz Classification Heating Mounting Tamb - 7 ~35 KW 4: 3(4)xxV~ 0: None NON: N/A F: Free standing A: -20 °C to 50 °C *see the table 3: 3Ph. B: Zone2, IIB STM: Steam W: Wall mount B: -20 °C to 55 °C X: Redundant (Dual frame) 6: 60Hz, 5: 50Hz H: Zone1, IIB+H2 E03~24 KW: Electric H: Horizontal C: -20 °C to 60 °C C: Zone1, IIC M: Interior : IIC

©









Ex APPROVAL

II 2G Ex IIB / IIB+H2 / IIC T3 Gb

II 2G Ex IIB / IIB+H2 / IIC T3 Gb

(Ex) ATEX : SIRA 11ATEX6387X

Standard (Zone 1): II 2G c IIC T3
Optional (Zone 2): II 3G c IIB T3-External

(II 2G c IIC T3-Internal)


100% Redundant HVAC system Well-VAC™ WC Series

- Key Up to Zone 1, Gas Group IIB / IIB+H2 / IIC, T3
- (Ex) Up to Zone 1, Gas Group IIB / IIC, T3 (200°C)
- R134a Non-Ozone Depleting Refrigerant
- Cool, heat, & redundant pressurize unit which automatically back-up for seamless running
- Maintains positive room pressure 50 Pascal and provides make-up air for ventilation
- Ambient temperature (depending on used component)
 -20 / -40°C to up +60°C
- Alarm lamps and the control switch for the
 HVAC units status control and monitoring system
- HVAC system control panel logic is done with PLC
- Temperature controller with indicator, Heating/Cooling mode or Cooling/High temperature alarm
- Wide range of voltage and frequencies available
- Free standing and Wall or Horizontal mount both available
- Fresh air stack connection with dust filter
- Low ventilation air flow switches

Optional Specification

- Control Box(station) Installation
 -Room inside(default) / -Room outside(alternative)
- Air Outlet (supplying to room)
 - -Front outlet(default) / -Top outlet(alternative)
- Mounting Type
 - -Wall mounting(default) / -Free standing off(alternative)
- Material
 - -AISI304(default) / AISI316(alternative)
- Emergency shut-down switch, Main power MCB, Room DPS/DPI, Room Temp. High Alarm, Sand filter, Chemical filter, Motorized damper, Safety(Detectors) integration and etc. available as an option(and by request)

DIMENSIONS AND APPLICATION

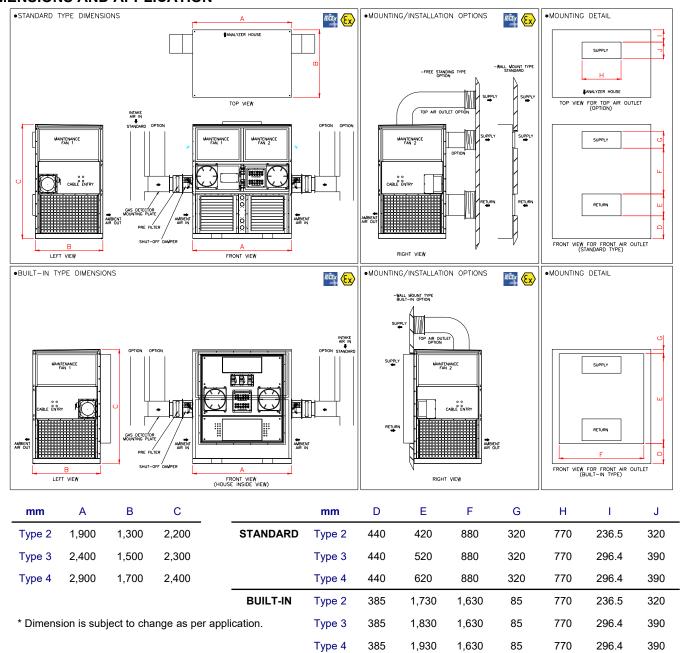

APPLICATION DATA SHEET

* Other specifications by request

Area & Design Conditions: Site Location:	Building & Internal Heat Load Information: Dimensions X (LWH) Meters
Summer Dry Bulb:°C, Wet Bulb:°C, Humidity%RH Winter Dry Bulb:°C, Wet Bulb:°C, Humidity%RH Internal Requirement :°C,%RH	Walls Insulation Thickness Roof Insulation Thickness Floor Insulation Thickness
Heating Load: LightsWatts, EquipmentWatts, Personnel(No.) Humidity Control □ is required □ is not required	Building Ventilation and/or Pressurization: □ 0.2" W.C.(50Pascal) or Air Changes per Hour
Additional utilities & environment requirements: Electric power:	Additional: * Additional: ☐ Fire damper ☐ High temp. alarm ☐ Room DPI/S * Heating: ☐ Steam ☐ Elec. ☐ ☐ Purafil ☐ 316SS
Area classification:	

